


Analogue Addressable Panel

Type 5 with Isolator and Speaker Bases

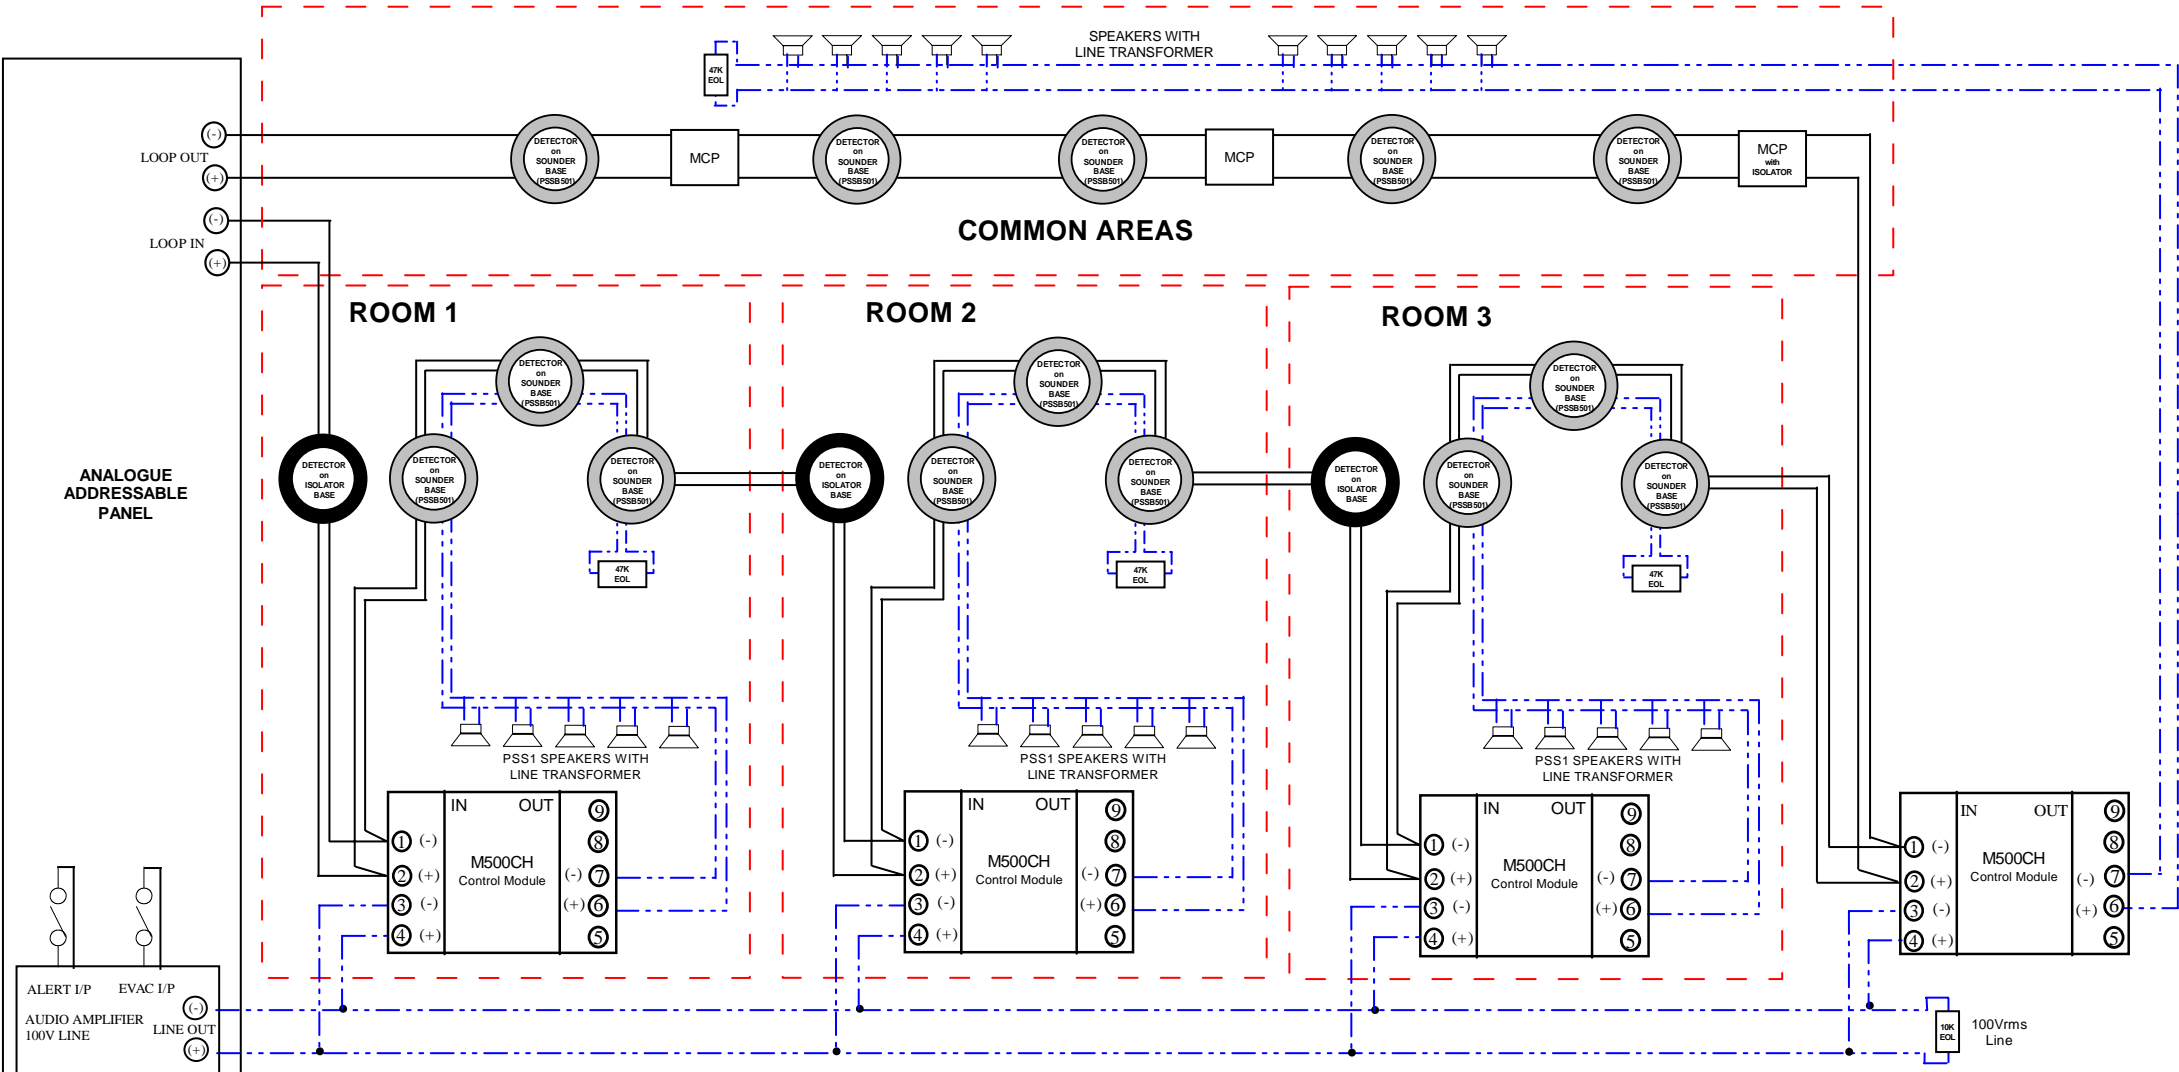

Detectors may be either Smoke or Heat detectors.
 Each detector may be mounted on one of:
 a) B501 standard base
 b) PSSB501 Sounder base
 c) B524IEFT Isolator base

An Isolator Base is required to provide short-circuit protection for each apartment.

Sufficient Speakers are required to meet local regulations for sound level in the event of an alarm.
 Because the Isolator base cannot provide a speaker output, care is required with base selection and layout to meet this requirement.
 Extra Sounder bases or PSS1 speakers may be required.

Key:
Analogue Loop:
Amplifier 100Vrms Line:
Room/Apartment Boundary:

Title:	Analogue Addressable Panel: Type 5 System with Isolated Base
Issue Number:	Issue 1.2
Date:	29 July, 2005
Drawing:	G M Tustin
Checked:	B A Pells